

LCLS Room Data Sheet #	1.9-1011	Undulator Hall (UH) - Service Building #1	Revision 2
-------------------------------	-----------------	--	-------------------

Javier A Sevilla
Owner / Editor

8/15/05

Signature

Date

Jim Welch
Conventional Facilities System
Physicist

8/16/05

Signature

Date

David Saenz
Conventional Facilities System
Manager

8/15/05

Signature

Date

Stephen Milton
Undulator WBS Manager

23 Aug 05

Signature

Date

Dave Schultz
E-Beam System Manager

8/18/05

Signature

Date

Darren Marsh
Quality Assurance Manager

8/17/05

Signature

Date

REVISION INFORMATION

Rev 2. Updated distance for first cable penetration and distance between penetrations. Added diversity factor for power.

Added figure for power plan. General delitions. Changed lighting level



Added requirements for electrical panel for utility outlets in UH Hall

ROOM DATA SHEETS

WBS and System Manager: Steve Milton/Dave Schultz

FACILITY COMPONENT	SERVICE BUILDING "1" UNDULATOR HALL										
	Name of Building	Service Building "#1"-Undulator Hall									
	Organization or Department	SLAC, Stanford University									
	Net area	123 sq. meters 1323 sq. ft									
	Critical dimensions	<table border="1"> <tr> <td>H:</td> <td>3.66 m</td> <td>12'</td> </tr> <tr> <td>W:</td> <td>4.57 m</td> <td>15 ft min</td> </tr> <tr> <td>L:</td> <td>~27 m</td> <td>~88 ft</td> </tr> </table>	H:	3.66 m	12'	W:	4.57 m	15 ft min	L:	~27 m	~88 ft
H:	3.66 m	12'									
W:	4.57 m	15 ft min									
L:	~27 m	~88 ft									
	Hours of operation	Facility is locked 24/7/365 (periodic maintenance only)									
	Users/Occupancy	Only during service and maintenance periods									
	Building orientation	West to east above the Undulator hall-tunnel									
FUNCTIONAL OBJECTIVE	Service Building #1 is to house the equipment use to power and control the undulator components. Including, rack mounted diagnostic equipment and free standing power supplies to run/monitor magnets and other equipment.										
PLANNING CONSIDERATIONS & CRITICAL FACTORS	<p>a) Placement of building and penetrations must minimize the maximum cable run lengths (including within said building) in housing of 150' in both upstream and downstream directions. The HVAC and cable penetrations shall comply with all radiation physics requirements.</p> <p>b) Provide floor space for tempered water chillers which provide cooling to electromagnets. QTY: TBD, Dimensions: TBD. SLAC furnished chillers</p>										
FINISHES		Corrugated steel, insulated, painted surface (SLACHome Spun brown exterior)									
	Ceiling	Corrugated steel, insulated									
	Floor	Epoxy sealed concrete									
	Base	Rubber									
	Doors	Two pair of personnel doors 3' x 7' with small window (locate at each end of building), 1 roll-up door (12' W x10" H) centered for equipment access.									
	Fenestrations	None									
	Acoustical/Thermal	None									
APPLICABLE STANDARDS	<p>29 CFR Part 1910 Occupational Safety Health Standard Dept of Labor, 29 CFR Part 1926 Safety and Health regulations for Construction Dept of Labor</p> <p>Uniform Building Code (UBC) 1997 including appendixes, National Electrical Code (NEC) 2002,</p> <p>2003 Uniform Mechanical Code (UMC) including appendixes, 2003 Uniform Plumbing Code (UPC) including appendixes,</p> <p>Uniform Fire Code (UFC) including appendixes, California Code of Regulations title 8 Industrial Safety,</p> <p>Title 19 Public Safety, NFPA 70 National Fire Codes, National Electrical Safety Code ANSI C2,</p> <p>Occupational Safety Health Act (OSHA), General Services Administration 41 CFR part 101-19,</p> <p>Environmental Protection Agency 40 CFR Parts 264 and 265</p> <p>Fire Marshall requirements, LCLS Cabling Standard, SLAC LOTO</p> <p>SLAC Environmental safety and Health Manual, General Industrial Activities Storm Water Permit (SLAC Permit), NFPA 101</p> <p>Life Safety Code, Title 24 Regulations for Energy Code (Part 6), DOE Standard 10 CFR Part 435, ASHRAE/IES Standard 90.1, NFPA Standard 13 and SLAC LOTO</p>										

IEWS & SCHEMATICS (N. T. S.)

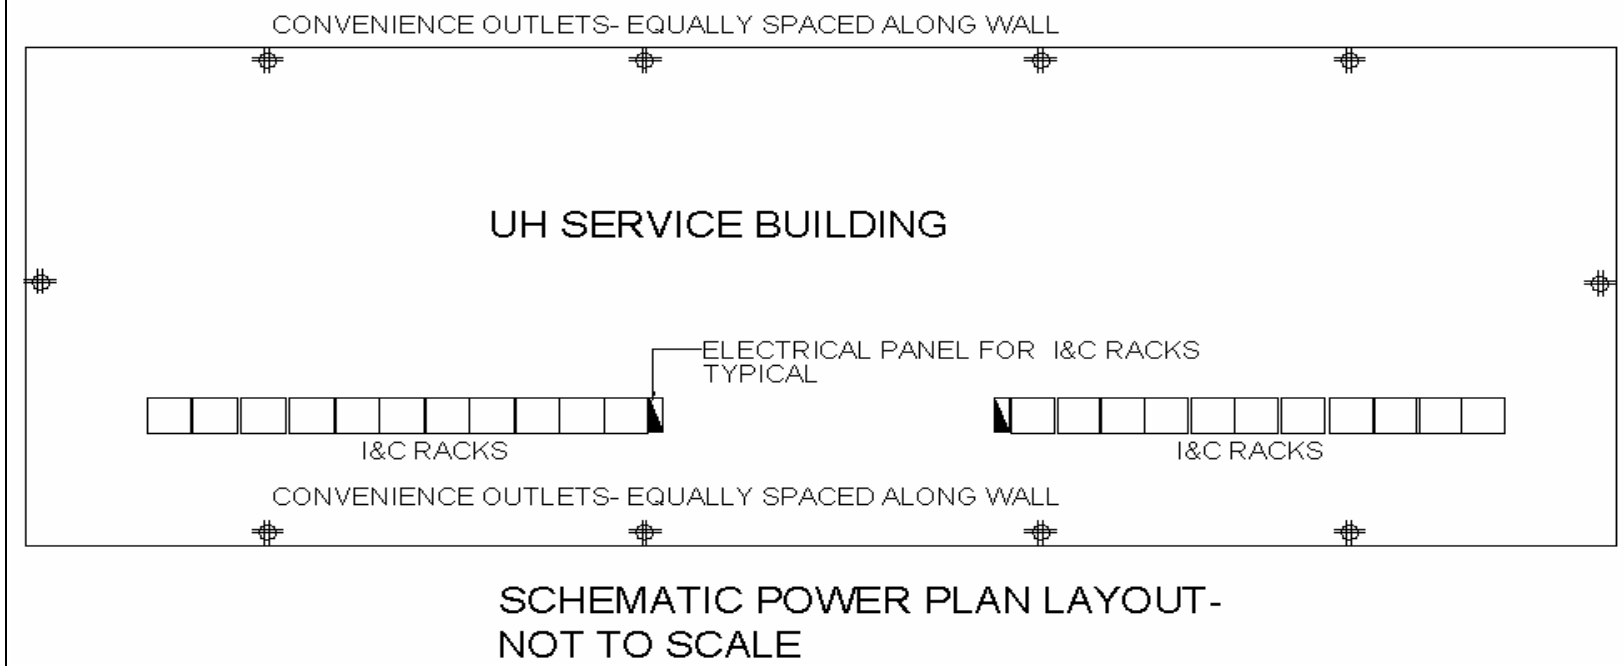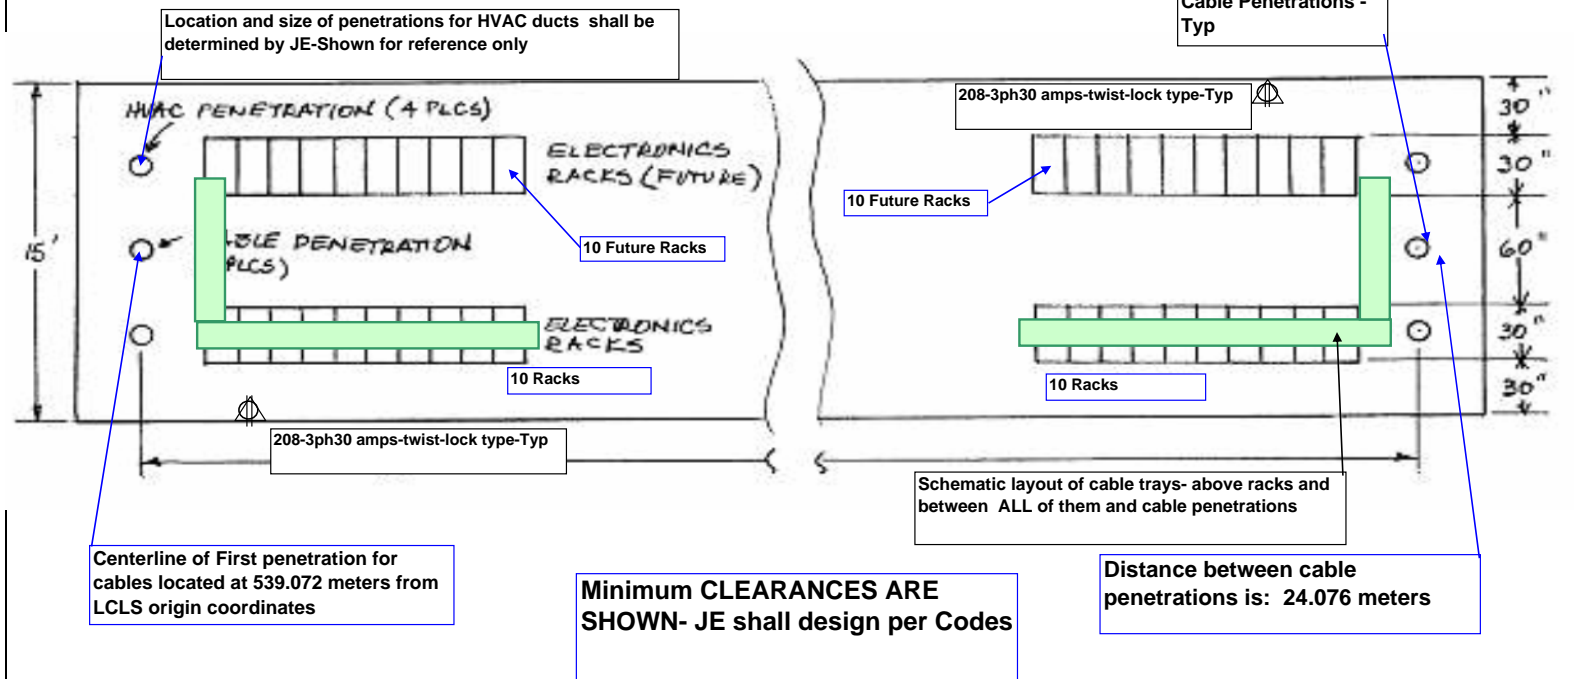

MECHANICAL REQUIREMENTS	HVAC					
		<input checked="" type="checkbox"/>	Heating system	Temp:	<input type="checkbox"/>	Mechanical humidification
		<input checked="" type="checkbox"/>	Air conditioning	74 F	<input type="checkbox"/>	Direct exhaust system
		<input type="checkbox"/>	Direct supply		<input checked="" type="checkbox"/>	Positive pressure system-slightly 0.01"
		<input type="checkbox"/>	Indirect supply		<input type="checkbox"/>	Negative pressure system
		<input type="checkbox"/>	Smoke control system		<input type="checkbox"/>	Standard registers
		<input checked="" type="checkbox"/>	Temperature sensors connected to SLAC's DDC system		<input type="checkbox"/>	Requirement for gases
		List of Gases - NONE		Comments: a) HVAC - Space Temperature shall be designed for +/-5 degree F control. No relative humidity control is required b) HVAC penetrations, diameter and size-TDB by JE. Shelter for HVAC equipment per JE design criteria. c) Locate HVAC equipment closer to penetrations and ducting to be run from equipment room through building d) Average Heat rejected load per single rack: 2 kw		
	Communications	<input checked="" type="checkbox"/>	Telephone- One phone line at two location		<input type="checkbox"/>	PA speakers
		<input checked="" type="checkbox"/>	Data port- 2 outlets-two location per building		<input type="checkbox"/>	PA station
			Payphone			CCTV camera
		<input checked="" type="checkbox"/>	Fire alarm station		<input type="checkbox"/>	CCTV monitor
		<input type="checkbox"/>	Intercom			
		Comments: a) Telephone stations are for maintenance & emergency use only. Locate one data and phone outlet at each end of the building. b) Two cable penetrations (24" diameter) located centerline of the building and at either side. Refer to Figure c) Two (24" wide) cable trays above the I&C racks to be installed with at least 20" vertical clearance. Cable trays shall be 6" deep for I&C cables and control cables for DC racks, and 4" deep for cables for DC racks.				
	Plumbing/Fire Protection	<input type="checkbox"/>	Hot water system		<input type="checkbox"/>	Electric water cooler
		<input type="checkbox"/>	Cold water system		<input type="checkbox"/>	Drinking fountain
		<input type="checkbox"/>	Tempered water		<input checked="" type="checkbox"/>	Smoke detection system
		<input type="checkbox"/>	Waste drain		<input checked="" type="checkbox"/>	Wet Sprinkler System
		<input type="checkbox"/>	Floor drain		<input type="checkbox"/>	Eye wash
		<input type="checkbox"/>	Trench drain			
		Comments: If needed locate sprinkler riser in the mechanical room (or outside the building) but not in the area where the I&C racks will be installed				

ELECTRICAL REQUIREMENTS	Power supply	<input checked="" type="checkbox"/>	208 Volts, 3 phase-outlets-See comments below	<input type="checkbox"/>	Uninterrupted power supply	
		<input checked="" type="checkbox"/>	110V outlets -See comments below	<input checked="" type="checkbox"/>	Special electric	
			Emergency power	<input checked="" type="checkbox"/>	Clean Power	
		Comments: a) Provide dedicated 30A outlets, 208 volts, 3 phase for equipment and tools. b) Provide convenience receptacles (20 amps, 120 volts 1 phase) along the perimeter walls. c) Provide two (2) panels, 120-208 volts, 3 ph "clean" power, 42 circuits/each. Provide (10) ten 30 amps circuits as minimum. Capacity of each panel 150 amps. Each panel shall have a main breaker with a minimum capacity of 150 amps. All panels should have 20% spare capacity for additional breaker space. Diversity factor: 50 %. d) Provide one panel with 24 circuits, 20 amps/each for Undulator Hall utility outlets. Diversity factor: 50%.				
	Lighting	<input checked="" type="checkbox"/>	Light fixtures	<input type="checkbox"/>	Remote lighting control	
			Fixture type I: Down light	<input checked="" type="checkbox"/>	Light switches	
		<input checked="" type="checkbox"/>	Fixture type II: Bollard (exterior)	<input checked="" type="checkbox"/>	Lighting level	FC: 75
		<input checked="" type="checkbox"/>	Emergency lighting			
Comments: a) Fixtures are pendant fluorescent, low profile. Location on centerline of building as well as on either side to supply adequate illumination for work in front and behind the racks.						
RADIATION/SEISMIC/VIBRATIONS ISSUES	Comments: a) Keep clear of 1 foot for cable penetrations for radiation protection.					
SPECIAL REQUIREMENTS FOR EQUIPMENT	Comments: a) Dimensions of each "single bay" electronic rack are: 22" Wide x 30" D x 88" H.					
ENVIRONMENTAL NEEDS						