



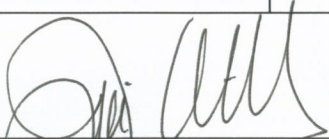




LCLS Room Data Sheet #	1.9-1013	Undulator Hall (UH) - Service Building #3	Revision 2
-------------------------------	-----------------	--	-------------------

Javier A. Sevilla Owner / Editor		8/15/05
	Signature	Date
Jim Welch Conventional Facilities System Physicist		8/15/05
	Signature	Date
David Saenz Conventional Facilities System Manager		8/15/05
	Signature	Date
Eric Bong Injector-Linac WBS Manager		8/15/05
	Signature	Date
Stephen Milton Undulator WBS Manager		23 Aug 05
	Signature	Date
Dave Schultz E-Beam System Manager		8/18/05
	Signature	Date
Darren Marsh Quality Assurance Manager		8/16/05
	Signature	Date



REVISION INFORMATION

Rev 2. Updated distance for first cable penetrations and distance between penetrations. Added diversity factor for power.
 Added figure for power plan. General delitions. Changed lighting level. Rearranged location of racks for EBD
 Added requirements for electrical panel for utility outlets in UH Hall

ROOM DATA SHEETS

WBS and System Manager: Steve Milton/Eric Bong/Dave Schultz

FACILITY COMPONENT	SERVICE BUILDING "3" UNDULATOR HALL																										
	<table border="1"> <tr> <td>Name of Building</td> <td colspan="2">Service Building "#3"-Undulator Hall</td> </tr> <tr> <td>Organization or Department</td> <td colspan="2">SLAC, Stanford University</td> </tr> <tr> <td>Net area</td> <td>128 sq. meters</td> <td>1380 sq. ft</td> </tr> <tr> <td rowspan="3">Critical dimensions</td> <td>H:</td> <td>3.66 m 12'</td> </tr> <tr> <td>W:</td> <td>4.57 m 15 ft min</td> </tr> <tr> <td>L:</td> <td>~28 m ~92 ft</td> </tr> <tr> <td>Hours of operation</td> <td colspan="2">Facility is locked 24/7/365 (periodic maintenance only)</td> </tr> <tr> <td>Users/Occupancy</td> <td colspan="2">Only during service and maintenance periods</td> </tr> <tr> <td>Building orientation</td> <td colspan="2">West to east above the Undulator hall-tunnel</td> </tr> </table>		Name of Building	Service Building "#3"-Undulator Hall		Organization or Department	SLAC, Stanford University		Net area	128 sq. meters	1380 sq. ft	Critical dimensions	H:	3.66 m 12'	W:	4.57 m 15 ft min	L:	~28 m ~92 ft	Hours of operation	Facility is locked 24/7/365 (periodic maintenance only)		Users/Occupancy	Only during service and maintenance periods		Building orientation	West to east above the Undulator hall-tunnel	
Name of Building	Service Building "#3"-Undulator Hall																										
Organization or Department	SLAC, Stanford University																										
Net area	128 sq. meters	1380 sq. ft																									
Critical dimensions	H:	3.66 m 12'																									
	W:	4.57 m 15 ft min																									
	L:	~28 m ~92 ft																									
Hours of operation	Facility is locked 24/7/365 (periodic maintenance only)																										
Users/Occupancy	Only during service and maintenance periods																										
Building orientation	West to east above the Undulator hall-tunnel																										
FUNCTIONAL OBJECTIVE	Service Building # 3 is to house the equipment use to power and control the undulator components. Including, rack mounted diagnostic equipment and free standing power supplies to run/monitor magnets and other equipment.																										
PLANNING CONSIDERATIONS & CRITICAL FACTORS	<p>a) Placement of building and penetrations must minimize the maximum cable run lengths (including within said building) in housing of 150' in both upstream and downstream directions. The HVAC and cable penetrations shall comply with all radiation physics requirements.</p> <p>b) Provide floor space for tempered water chillers which provide cooling to electromagnets. QTY: TBD, Dimensions: TBD. SLAC furnished chillers</p>																										
FINISHES	<table border="1"> <tr> <td></td> <td colspan="2">Corrugated steel, insulated, painted surface (SLACHome Spun brown exterior)</td> </tr> <tr> <td>Ceiling</td> <td colspan="2">Corrugated steel, insulated</td> </tr> <tr> <td>Floor</td> <td colspan="2">Epoxy sealed concrete</td> </tr> <tr> <td>Base</td> <td colspan="2">Rubber</td> </tr> <tr> <td>Doors</td> <td colspan="2">Two pair of personnel doors 3' x 7' with small window (locate at each end of building), 1 roll-up door (12' W x10" H) centered for equipment access.</td> </tr> <tr> <td>Fenestrations</td> <td colspan="2">None</td> </tr> <tr> <td>Acoustical/Thermal</td> <td colspan="2">None</td> </tr> </table>			Corrugated steel, insulated, painted surface (SLACHome Spun brown exterior)		Ceiling	Corrugated steel, insulated		Floor	Epoxy sealed concrete		Base	Rubber		Doors	Two pair of personnel doors 3' x 7' with small window (locate at each end of building), 1 roll-up door (12' W x10" H) centered for equipment access.		Fenestrations	None		Acoustical/Thermal	None					
	Corrugated steel, insulated, painted surface (SLACHome Spun brown exterior)																										
Ceiling	Corrugated steel, insulated																										
Floor	Epoxy sealed concrete																										
Base	Rubber																										
Doors	Two pair of personnel doors 3' x 7' with small window (locate at each end of building), 1 roll-up door (12' W x10" H) centered for equipment access.																										
Fenestrations	None																										
Acoustical/Thermal	None																										
APPLICABLE STANDARDS	<p>29 CFR Part 1910 Occupational Safety Health Standard Dept of Labor, 29 CFR Part 1926 Safety and Health regulations for Construction Dept of Lab</p> <p>Uniform Building Code (UBC) 1997 including appendixes, National Electrical Code (NEC) 2002,</p> <p>2003 Uniform Mechanical Code (UMC) including appendixes, 2003 Uniform Plumbing Code (UPC) including appendixes,</p> <p>Uniform Fire Code (UFC) including appendixes, California Code of Regulations title 8 Industrial Safety,</p> <p>Title 19 Public Safety, NFPA 70 National Fire Codes, National Electrical Safety Code ANSI C2,</p> <p>Occupational Safety Health Act (OSHA), General Services Administration 41 CFR part 101-19,</p> <p>Environmental Protection Agency 40 CFR Parts 264 and 265</p> <p>Fire Marshall requirements, LCLS Cabling Standard, SLAC LOTO</p> <p>SLAC Environmental safety and Health Manual, General Industrial Activities Storm Water Permit (SLAC Permit), NFPA 101</p> <p>Life Safety Code, Title 24 Regulations for Energy Code (Part 6), DOE Standard 10 CFR Part 435, ASHRAE/IES Standard 90.1, NFPA Standard 13 and SLAC LOTO</p>																										

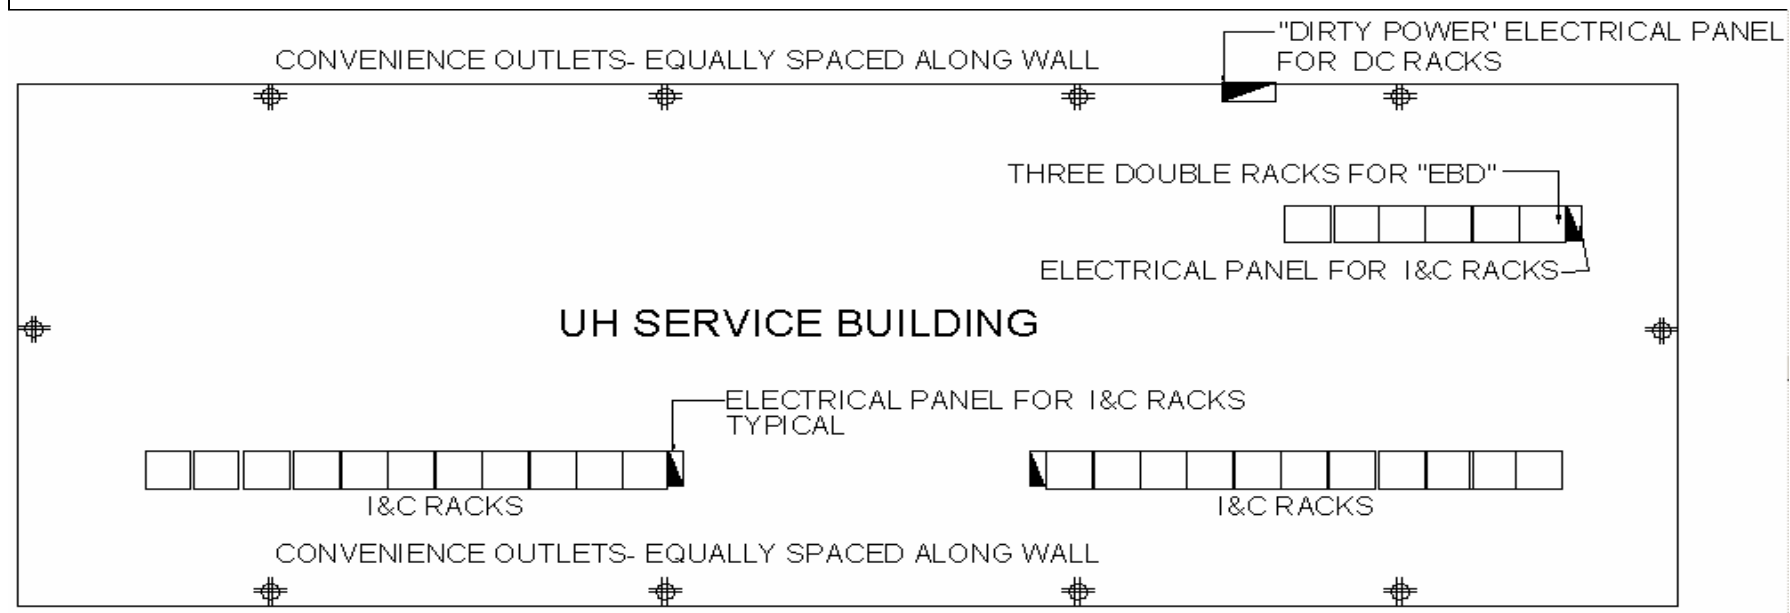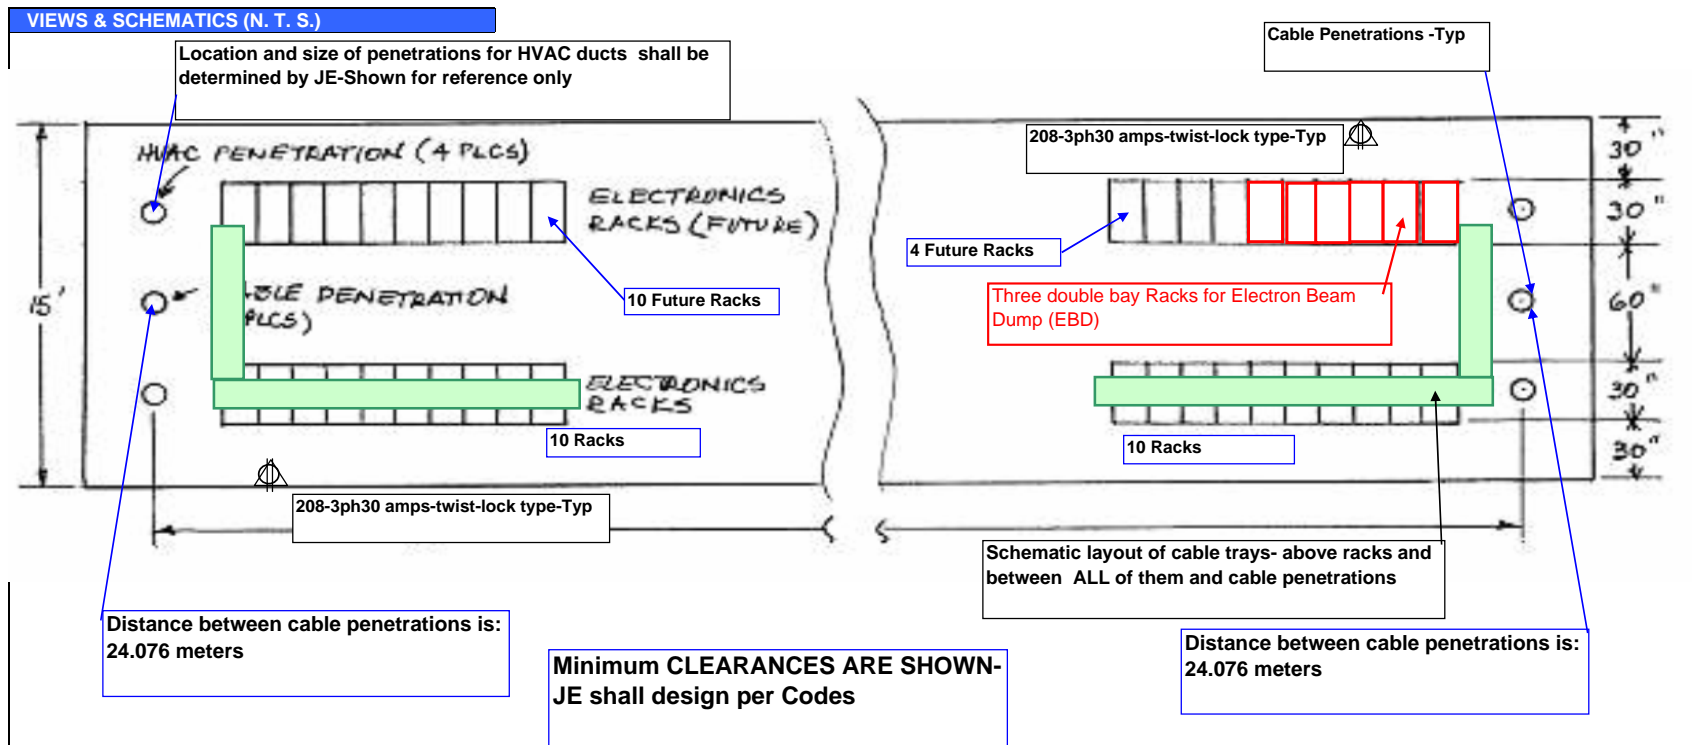

SCHEMATIC POWER PLAN LAYOUT- NOT TO SCALE

MECHANICAL REQUIREMENTS	HVAC																																			
	<table border="1"> <tr> <td><input checked="" type="checkbox"/></td> <td>Heating system</td> <td>Temp:</td> <td><input type="checkbox"/></td> <td>Mechanical humidification</td> </tr> <tr> <td><input checked="" type="checkbox"/></td> <td>Air conditioning</td> <td>74 F</td> <td><input type="checkbox"/></td> <td>Direct exhaust system</td> </tr> <tr> <td><input type="checkbox"/></td> <td>Direct supply</td> <td></td> <td><input checked="" type="checkbox"/></td> <td>Positive pressure system-slightly 0.01"</td> </tr> <tr> <td><input type="checkbox"/></td> <td>Indirect supply</td> <td></td> <td><input type="checkbox"/></td> <td>Negative pressure system</td> </tr> <tr> <td><input type="checkbox"/></td> <td>Smoke control system</td> <td></td> <td><input type="checkbox"/></td> <td>Standard registers</td> </tr> <tr> <td><input checked="" type="checkbox"/></td> <td>Temperature sensors connected to SLAC's DDC system</td> <td></td> <td><input type="checkbox"/></td> <td>Requirement for gases</td> </tr> <tr> <td colspan="2">List of Gases - NONE</td> <td colspan="3">Comments: a) HVAC - Space Temperature shall be designed for +/-5 degree F control. No relative humidity control is required b) HVAC penetrations, diameter and size-TDB by JE. Shelter for HVAC equipment per JE design criteria. c) Locate HVAC equipment closer to penetrations and ducting to be run from equipment room through building d) Average Heat rejected load per single rack: 2 kw</td> </tr> </table>	<input checked="" type="checkbox"/>	Heating system	Temp:	<input type="checkbox"/>	Mechanical humidification	<input checked="" type="checkbox"/>	Air conditioning	74 F	<input type="checkbox"/>	Direct exhaust system	<input type="checkbox"/>	Direct supply		<input checked="" type="checkbox"/>	Positive pressure system-slightly 0.01"	<input type="checkbox"/>	Indirect supply		<input type="checkbox"/>	Negative pressure system	<input type="checkbox"/>	Smoke control system		<input type="checkbox"/>	Standard registers	<input checked="" type="checkbox"/>	Temperature sensors connected to SLAC's DDC system		<input type="checkbox"/>	Requirement for gases	List of Gases - NONE		Comments: a) HVAC - Space Temperature shall be designed for +/-5 degree F control. No relative humidity control is required b) HVAC penetrations, diameter and size-TDB by JE. Shelter for HVAC equipment per JE design criteria. c) Locate HVAC equipment closer to penetrations and ducting to be run from equipment room through building d) Average Heat rejected load per single rack: 2 kw		
<input checked="" type="checkbox"/>	Heating system	Temp:	<input type="checkbox"/>	Mechanical humidification																																
<input checked="" type="checkbox"/>	Air conditioning	74 F	<input type="checkbox"/>	Direct exhaust system																																
<input type="checkbox"/>	Direct supply		<input checked="" type="checkbox"/>	Positive pressure system-slightly 0.01"																																
<input type="checkbox"/>	Indirect supply		<input type="checkbox"/>	Negative pressure system																																
<input type="checkbox"/>	Smoke control system		<input type="checkbox"/>	Standard registers																																
<input checked="" type="checkbox"/>	Temperature sensors connected to SLAC's DDC system		<input type="checkbox"/>	Requirement for gases																																
List of Gases - NONE		Comments: a) HVAC - Space Temperature shall be designed for +/-5 degree F control. No relative humidity control is required b) HVAC penetrations, diameter and size-TDB by JE. Shelter for HVAC equipment per JE design criteria. c) Locate HVAC equipment closer to penetrations and ducting to be run from equipment room through building d) Average Heat rejected load per single rack: 2 kw																																		
	Communications																																			
	<table border="1"> <tr> <td><input checked="" type="checkbox"/></td> <td>Telephone- One phone line at two location</td> <td><input type="checkbox"/></td> <td>PA speakers</td> </tr> <tr> <td><input checked="" type="checkbox"/></td> <td>Data port- 2 outlets-two location per building</td> <td><input type="checkbox"/></td> <td>PA station</td> </tr> <tr> <td></td> <td>Payphone</td> <td></td> <td>CCTV camera</td> </tr> <tr> <td><input checked="" type="checkbox"/></td> <td>Fire alarm station</td> <td><input type="checkbox"/></td> <td>CCTV monitor</td> </tr> <tr> <td><input type="checkbox"/></td> <td>Intercom</td> <td></td> <td></td> </tr> <tr> <td colspan="4">Comments: a) Telephone stations are for maintenance & emergency use only. Locate one data and phone outlet at each end of the building. b) Two cable penetrations (24" diameter) located centerline of the building and at either side. Refer to Figure c) Two (24" wide) cable trays above the I&C racks to be installed with at least 20" vertical clearance. Cable trays shall be 6" deep for I&C cables and control cables for DC racks, and 4" deep for cables for DC racks.</td> </tr> </table>	<input checked="" type="checkbox"/>	Telephone- One phone line at two location	<input type="checkbox"/>	PA speakers	<input checked="" type="checkbox"/>	Data port- 2 outlets-two location per building	<input type="checkbox"/>	PA station		Payphone		CCTV camera	<input checked="" type="checkbox"/>	Fire alarm station	<input type="checkbox"/>	CCTV monitor	<input type="checkbox"/>	Intercom			Comments: a) Telephone stations are for maintenance & emergency use only. Locate one data and phone outlet at each end of the building. b) Two cable penetrations (24" diameter) located centerline of the building and at either side. Refer to Figure c) Two (24" wide) cable trays above the I&C racks to be installed with at least 20" vertical clearance. Cable trays shall be 6" deep for I&C cables and control cables for DC racks, and 4" deep for cables for DC racks.														
<input checked="" type="checkbox"/>	Telephone- One phone line at two location	<input type="checkbox"/>	PA speakers																																	
<input checked="" type="checkbox"/>	Data port- 2 outlets-two location per building	<input type="checkbox"/>	PA station																																	
	Payphone		CCTV camera																																	
<input checked="" type="checkbox"/>	Fire alarm station	<input type="checkbox"/>	CCTV monitor																																	
<input type="checkbox"/>	Intercom																																			
Comments: a) Telephone stations are for maintenance & emergency use only. Locate one data and phone outlet at each end of the building. b) Two cable penetrations (24" diameter) located centerline of the building and at either side. Refer to Figure c) Two (24" wide) cable trays above the I&C racks to be installed with at least 20" vertical clearance. Cable trays shall be 6" deep for I&C cables and control cables for DC racks, and 4" deep for cables for DC racks.																																				
	Plumbing/Fire Protection																																			
	<table border="1"> <tr> <td><input type="checkbox"/></td> <td>Hot water system</td> <td><input type="checkbox"/></td> <td>Electric water cooler</td> </tr> <tr> <td><input type="checkbox"/></td> <td>Cold water system</td> <td><input type="checkbox"/></td> <td>Drinking fountain</td> </tr> <tr> <td><input type="checkbox"/></td> <td>Tempered water</td> <td><input checked="" type="checkbox"/></td> <td>Smoke detection system</td> </tr> <tr> <td><input type="checkbox"/></td> <td>Waste drain</td> <td><input checked="" type="checkbox"/></td> <td>Wet Sprinkler System</td> </tr> <tr> <td><input type="checkbox"/></td> <td>Floor drain</td> <td><input type="checkbox"/></td> <td>Eye wash</td> </tr> <tr> <td><input type="checkbox"/></td> <td>Trench drain</td> <td></td> <td></td> </tr> <tr> <td colspan="4">Comments: If needed locate sprinkler riser in the mechanical room (or outside the building) but not in the area where the I&C racks will be installed</td> </tr> </table>	<input type="checkbox"/>	Hot water system	<input type="checkbox"/>	Electric water cooler	<input type="checkbox"/>	Cold water system	<input type="checkbox"/>	Drinking fountain	<input type="checkbox"/>	Tempered water	<input checked="" type="checkbox"/>	Smoke detection system	<input type="checkbox"/>	Waste drain	<input checked="" type="checkbox"/>	Wet Sprinkler System	<input type="checkbox"/>	Floor drain	<input type="checkbox"/>	Eye wash	<input type="checkbox"/>	Trench drain			Comments: If needed locate sprinkler riser in the mechanical room (or outside the building) but not in the area where the I&C racks will be installed										
<input type="checkbox"/>	Hot water system	<input type="checkbox"/>	Electric water cooler																																	
<input type="checkbox"/>	Cold water system	<input type="checkbox"/>	Drinking fountain																																	
<input type="checkbox"/>	Tempered water	<input checked="" type="checkbox"/>	Smoke detection system																																	
<input type="checkbox"/>	Waste drain	<input checked="" type="checkbox"/>	Wet Sprinkler System																																	
<input type="checkbox"/>	Floor drain	<input type="checkbox"/>	Eye wash																																	
<input type="checkbox"/>	Trench drain																																			
Comments: If needed locate sprinkler riser in the mechanical room (or outside the building) but not in the area where the I&C racks will be installed																																				

ELECTRICAL REQUIREMENTS	Power supply	<input checked="" type="checkbox"/> 208 Volts, 3 phase-outlets-See comments below	<input type="checkbox"/>	Uninterrupted power supply	
		<input checked="" type="checkbox"/> 110V outlets -See comments below	<input checked="" type="checkbox"/>	Special electric	
		Emergency power		Clean Power	
		Comments: a) Provide dedicated 30A outlets, 208 volts, 3 phase for equipment and tools. b) Provide convenience receptacles (20 amps, 120 volts 1 phase) along the perimeter walls. c) Provide two (2) panels, 120-208 volts, 3 ph "clean" power. 42 circuits/each. Each panel shall have a main breaker with a minimum capacity of 150 amps. Provide (10) ten 30 amps circuits as minimum. All panels should have 20% spare capacity for additional breaker space. Diversity: 50 % d) Provide one (1) panel, 120-208 volts, 3 ph "clean" power. Capacity of each panel 125 amps. 42 circuits. Each panel shall have a main breaker with a minimum capacity of 125 amps. All panels should have 20% spare capacity for additional breaker space. Diversity: 70 %. This panel is for the Control Diagnostics & Vacuum of Electron Beam. e) Provide one (1) panel, 120-208 volts, 3 ph "Dirty" power. 42 circuits. Capacity of each panel 125 amps. Each panel shall have a main breaker with a minimum capacity of 125 amps. All panels should have 20% spare capacity for additional breaker space. Diversity: 70 %. This panel is for the DC Racks and power supplies for Electron Beam.			
	Lighting	<input checked="" type="checkbox"/> Light fixtures	<input type="checkbox"/>	Remote lighting control	
		Fixture type I: Down light	<input checked="" type="checkbox"/>	Light switches	
		<input checked="" type="checkbox"/> Fixture type II: Bollard (exterior)	<input checked="" type="checkbox"/>	Lighting level	FC: 75
		<input checked="" type="checkbox"/> Emergency lighting			
		Comments: a) Fixtures are pendant fluorescent, low profile. Location on centerline of building as well as on either side to supply adequate illumination for work in front and behind the racks.			
RADIATION/SEISMIC/VIBRATIONS ISSUES	Comments:				
	a) Keep clear of 1 foot for cable penetrations for radiation protection.				
SPECIAL REQUIREMENTS FOR EQUIPMENT	Comments:				
	a) Dimensions of each "single bay" electronic rack are: 22" Wide x 30" D x 88" H.				
	b) Dimensions of each "Double bay" electronic rack are: 50" Wide x 36" D x 88" H.-Shown in red color				
ENVIRONMENTAL NEEDS					