



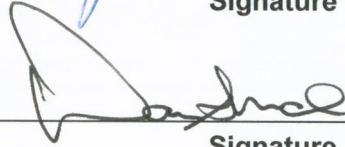


<b>LCLS Room Data Sheet #</b>	<b>1.9-1039</b>	<b>Far Experimental Hall (FEH) - Hutch #2</b>	<b>Revision 2</b>
-------------------------------	-----------------	-----------------------------------------------	-------------------

Javier A. Sevilla Owner / Editor		8/15/05
	<b>Signature</b>	<b>Date</b>
Jim Welch Conventional Facilities System Physicist		8/16/05
	<b>Signature</b>	<b>Date</b>
David Saenz Conventional Facilities System Manager		8/15/05
	<b>Signature</b>	<b>Date</b>
Stefan Moeller X-R End stations WBS Manager		8/16/05
	<b>Signature</b>	<b>Date</b>
John Arthur Photon Beam System Manager		8-16-05
	<b>Signature</b>	<b>Date</b>
Darren Marsh Quality Assurance Manager		8/17/05
	<b>Signature</b>	<b>Date</b>

<p><b>REVISION INFORMATION</b></p> <p>Rev 2. Deleted N2 central gas system, delete wrong layout fig #2, added wall penetration fig #3. Added Figure No. 4          Changed amperage, 110 volts, 20 amps outlets. Updated Code and Standards          Added hutch and control area layout. Added power diversity factor. Clarifications to cable trays requirements          Added LCLS ESD 1.9-103 and 1.9-104 . General changes and corrections</p>
------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------


ROOM DATA SHEETS

WBS and System Manager: Stefan Moeller/John Arthur

FACILITY COMPONENT		HUTCH #2 (3 each in FEH includes control area) - ROOM DATA SHEET										
		<b>Name of Building</b>	Hutch # 2 in FEH									
		<b>Organization or Department</b>	SLAC, Stanford University									
		<b>Net area</b>	95.0 sq. meters 1023sf									
		<b>Critical dimensions</b>	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 30%;"><b>H:</b></td> <td style="width: 30%;">4.5 m</td> <td style="width: 40%;">15'-0"</td> </tr> <tr> <td><b>W:</b></td> <td>9.5 m</td> <td>31'-2"</td> </tr> <tr> <td><b>L:</b></td> <td>10.0 m</td> <td>32'-9"</td> </tr> </table>	<b>H:</b>	4.5 m	15'-0"	<b>W:</b>	9.5 m	31'-2"	<b>L:</b>	10.0 m	32'-9"
<b>H:</b>	4.5 m	15'-0"										
<b>W:</b>	9.5 m	31'-2"										
<b>L:</b>	10.0 m	32'-9"										
		<b>Hours of operation</b>	24/7/365									
		<b>Users/Occupancy</b>	5									
		<b>Building orientation</b>	Located along the beam line on the FEH level.									
FUNCTIONAL OBJECTIVE		To conduct a variety of experiments with the high energy X-ray beam. One of the hutches in the NEH also houses special optical devices, that help split the X-ray beam into the +/- 3/4 degree beams. For hutch layout see figure 2.										
PLANNING CONSIDERATIONS & CRITICAL FACTORS		Floor level is to remain constant throughout the entire length of the BTH at 1.4m below the beam axis. Y = - 0.895305m in LCLS coordinate system (refer to LCLS-TN-03-8). Each hutch should have it's longer side parallel to the direction of beam travel. The hutches should be capable of independent operations. Provide modular hutch design flexible for future expansions and modifications. Refer to LCLS ESD 1.9-103 General Concrete Guideline										
FINISHES		Wall	Gypsum board walls, painted surface and 1/8in. of Lead for all hutch walls. Provide modular hutch design flexible for future expansions and modifications. Penetrations 6" diameter, every 4ft, can not allow line of sight to beam lines. (see figure 3)									
		Ceiling	Gypsum board, painted surface, painted surface and 1/8in of lead. 15'-0"high. Ceiling structure with suspended Unistrut framing grid capable of supporting experiment specific diagnostic equipment on suspended shelf below the ceiling above each laser table. Each shelf estimated weight is 500 lbs each. Bottom of unistrut framing grid: 12'-0"AFF									
		Floor	Sealed concrete with epoxy coating- Refer to LCLS ESD 1.9-103 General Concrete Guideline									
		Base	None allowed.									
		Doors	Sliding Hutch doors should contain 1/8" lead. Door runs in groove. No cracks. Door height 8'-0". Width to allowed 5 ft entry space. Door must interface with special Personal Protection System(PPS). PPS provided by SLAC. Example of doors are similar to SSRL X-Ray hutch doors.									
		Fenestrations	None									
		Acoustical	None									

<b>APPLICABLE STANDARDS</b>	29 CFR Part 1910 Occupational Safety and Health Standards Dept of Labor, 29 CFR Part 1926 Safety and Health Regulations for Construction Dept of Labor, Uniform Building Code (UBC) 1997 including appendixes, National Electric Code (NEC) 2002, Uniform Mechanical Code (UMC) 2003 including appendixes, Uniform Plumbing Code (UPC) 2003 including appendixes, Uniform Fire Code (UFC) 1997 including appendixes, California Code of Regulations Title 8 Industrial Safety, Title 19 Public Safety, NFPA 70 National Fire Codes, National electrical Safety Code ANSI C2, Occupational Safety and Health Act (OSHA), General Services Administration 41 CFR part 101-19, Environmental Protection Agency 40 CFR Parts 264 and 265, SLAC Environmental Safety & Health Manual, General Industrial Activities Storm Water Permit (SLAC Permit), NFPA 101 life Safety Code, Title 24, DOE standard 10 CFR Part 435, ASHRAE/IES Standards 90.1, NFPA Standard 13 and SLAC Fire Marshal requirements, LCLS Cabling Standard, SLAC LOTO
-----------------------------	--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------


<b>IEWS &amp; SCHEMATICS (N. T. S.)</b>	<b>Figure 1 FEH Schematic Layout-Overall</b>
-----------------------------------------	----------------------------------------------

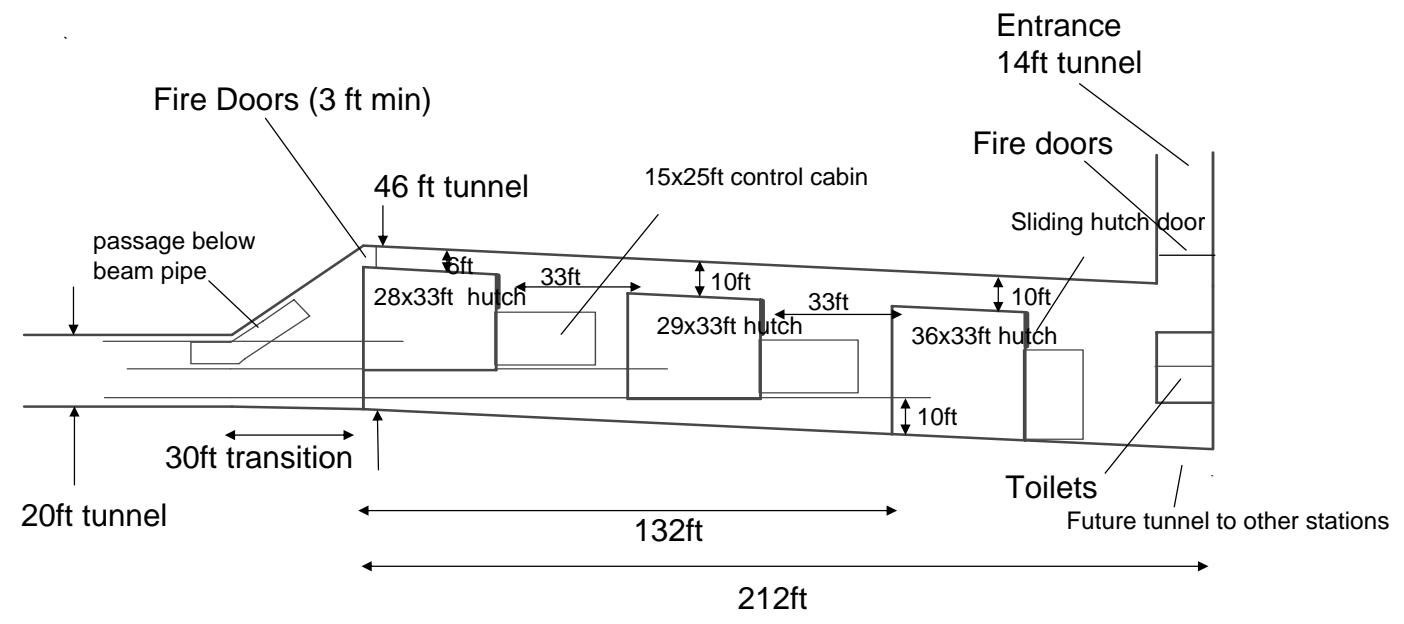

MECHANICAL REQUIREMENTS		HVAC	
Provide filtered clean air using pre-filters, high efficiency filters and HEPA filters in the air handling unit. 6 FPM average room velocity	<input checked="" type="checkbox"/>	Heating system	<input type="checkbox"/> Mechanical humidification
	<input checked="" type="checkbox"/>	Air conditioning	Temp: 72 degrees F ± 1 degree F <input checked="" type="checkbox"/> Direct exhaust system
	<input type="checkbox"/>	Direct supply	<input type="checkbox"/> Positive pressure system
	<input type="checkbox"/>	Indirect supply	<input type="checkbox"/> Negative pressure system
	<input type="checkbox"/>	Smoke control system	<input type="checkbox"/> Standard registers
	<input checked="" type="checkbox"/>	Temperature sensors connected to SLAC's DDC system	<input checked="" type="checkbox"/> Requirement for gases
		<p><b>List of Gases</b> - No centralized N2 gas system in FEH, local use of bottles only.</p> <p><b>Centralized Mechanical Utilities:</b> Clean dry oil-free compressed air 20 SCFM, 100 psig. Provide one location (along wall) with shut off valve and pressure gauge per hutch.</p>	<p>1) Noise criteria for HVAC system design: NC=35 2) Temperature fluctuation to be maximum of +/- 1 deg F for stability. 3) Relative Humidity (RH)- shall be controlled to 45% +/- 10% 4) Exhaust: 200 CFM exhaust ducts (6") for process exhaust at 1.5"W.C. static pressure for each hutch on separate fan for each hutch.</p>
	Communications		
	<input checked="" type="checkbox"/>	Telephone- 2 phone lines/location	<input type="checkbox"/> PA speakers
	<input checked="" type="checkbox"/>	Data port- 2 jacks/location	<input type="checkbox"/> PA station
	<input type="checkbox"/>	Payphone	<input type="checkbox"/> CCTV camera
	<input checked="" type="checkbox"/>	Fire alarm station	<input type="checkbox"/> CCTV monitor
	<input type="checkbox"/>	Intercom	
		<p><b>Comments:</b> 1) Provide two locations (data and voice) per wall 2) Cable trays: Double 12 inch to be installed along the inside walls of each hutch and along side hutch wall in control area and single 12 in grid in each hutch . Provide cable trays at 8'-6" ft AFF (see figure 2 for layout). Cable trays should be made from galvanized steel. Provide each cable tray with 1-4#0 bare copper wire for grounding. Provide 6" deep cable tray for I&amp;C cables and control cables for DC racks, and 4" deep for cables for DC racks.</p>	
	Plumbing/Fire Protection		
	<input type="checkbox"/>	Hot water system	<input type="checkbox"/> Electric water cooler
	<input checked="" type="checkbox"/>	Process cooling water	<input type="checkbox"/> Drinking fountain
	<input type="checkbox"/>	Tempered water	<input checked="" type="checkbox"/> Smoke detection systems with devices suitable for radiation environment
	<input type="checkbox"/>	Waste drain	<input checked="" type="checkbox"/> Wet Spinkler System
	<input type="checkbox"/>	Floor drain	<input type="checkbox"/> Eye wash
	<input type="checkbox"/>	Trench drain	
		<p><b>Comments:</b> Process Cooling water (PCW): 10GPM, 25 PSI at 68 F supply in each hutch. Refer to LCLS Water Cooling Specification. Terminate with shut off valve and pressure gauge. Locate piping on wall</p>	

<b>ELECTRICAL REQUIREMENTS</b>	<b>Power supply</b>	<input type="checkbox"/>	208V outlets-1 phase- 30 amps	<input type="checkbox"/>	Uninterrupted power supply
		<input checked="" type="checkbox"/>	110V, 1ph Double duplex outlets, 20 amps locate at 10ft apart on all walls.	<input checked="" type="checkbox"/>	Special electric-See below Type:
		<input type="checkbox"/>	Emergency power	a) Provide two panels, 120-208 volts, 3 ph, (one "clean" and one "dirty" power) in each hutch. Each panel shall have a main breaker. All panels should have 20% spare capacity and additional breaker space. Capacity: 42 circuits/panel. b) Capacity of each panel: <b>100</b> amps. Diversity factor: 60% <b>Panel location:</b> On walls next to door (see figure 2).	
		<b>Comments:</b> 1. Electrical distribution system in ceiling with vertical drops. 2. Cable trays: To be installed along the inside walls of each hutch (see figure 2 for layout) and alongside hutch wall in control area. 3. The two panels will provide power to future experimental equipment.			
	<b>Lighting</b>	<input checked="" type="checkbox"/>	Light fixtures	<input type="checkbox"/>	Remote lighting control
		<input checked="" type="checkbox"/>	Fixture type I: Down light	<input checked="" type="checkbox"/>	Light switches
		<input type="checkbox"/>	Fixture type II: Bollard (exterior)	<input checked="" type="checkbox"/>	Lighting level FC: 75
		<input checked="" type="checkbox"/>	Emergency lighting		
		<b>Comments:</b> 1- All conduits are surface mounted. Low profile fixtures preferred. 2- No night lighting desired. 3- Must have the ability to completely darken the room when required by the particular experiment. 4- Lighting level should be higher than normal standard office environment due to the dark laser protective goggles worn by the lab personnel. <b>(75 FC)</b> . 5- Light fixtures could be located at the lower unistrut level, placing the fixtures as close to the work surface as possible. 6- Refer to LCLS ESD 1.9-104 Emergency Lighting Specification			
<b>RADIATION/SEISMIC/VIBRATIONS ISSUES</b>	<b>Comments:</b> 1- All equipment (HVAC, cable trays, panels, etc) and systems are to be seismically braced and restrained per SLAC Seismic Standards and per Code. 2- Vibration criteria in the hutches: Refer to document: LCLS Vibration Specification B. (100 micro inch/sec.) 3- For cable penetration details, refer to figure 3. Allow for two 6 inch penetrations between hutches (one on each end)				
<b>SPECIAL REQUIREMENTS FOR EQUIPMENT</b>	<b>Comments:</b> 1- Each hutch is equipped with a "L" shaped mono rail electric crane (capacity 1 ton, hook height 12ft) which runs above the beam line and has a loading area adjacent to it (see figure 2). 2- Provide cable trays at 8'-6" ft AFF				
<b>CHEMICALS / GASES</b>	<b>CHEMICALS</b>			<b>SPECIALTY GASES</b>	
	#	Chemical Type	Quantity	#	Gas Type
<b>ENVIRONMENTAL NEEDS</b>					

Figure 2- SCHEMATIC PLAN VIEW OF HUTCH ROOM AND CONTROL AREA

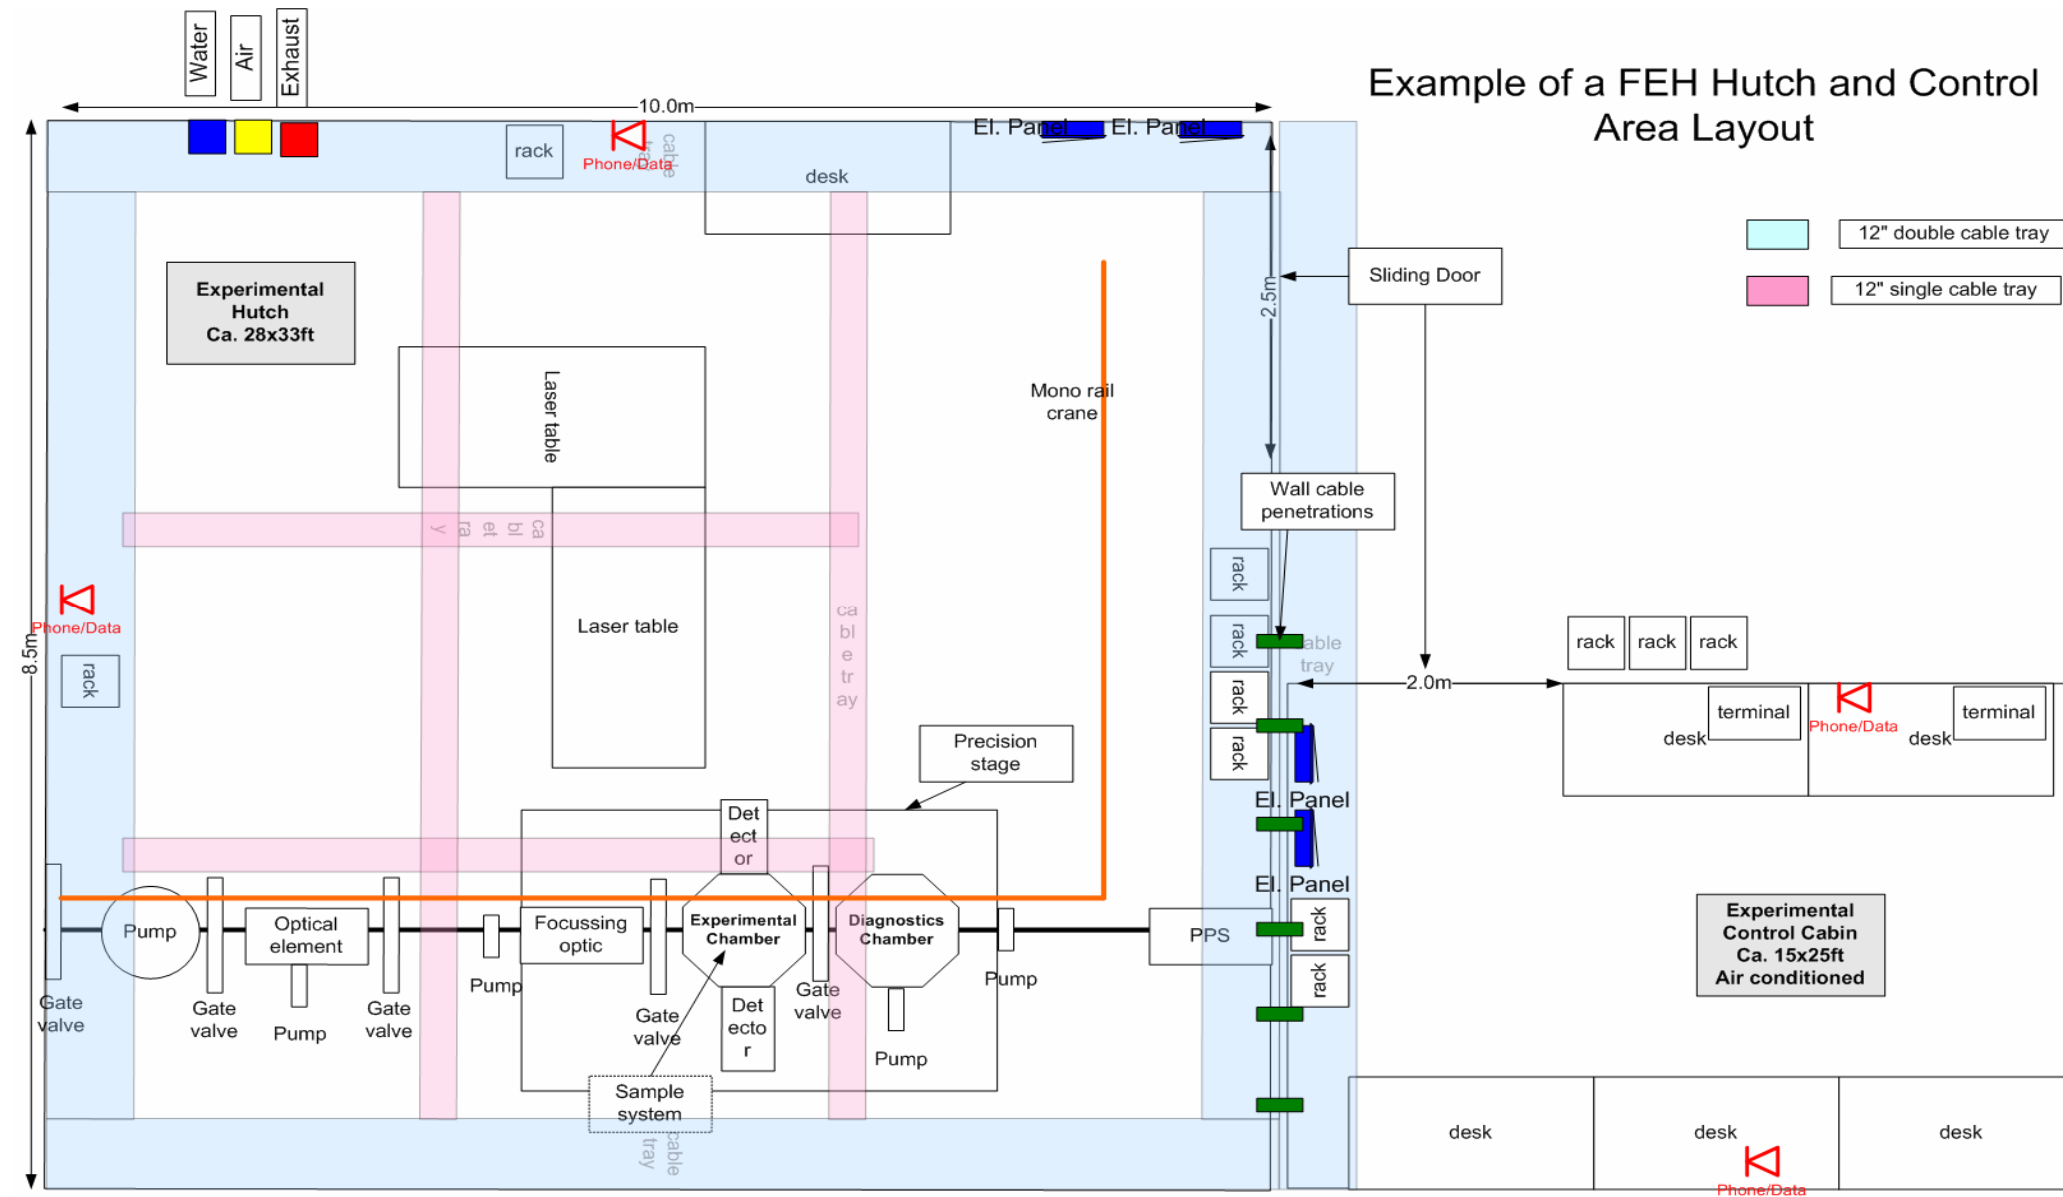

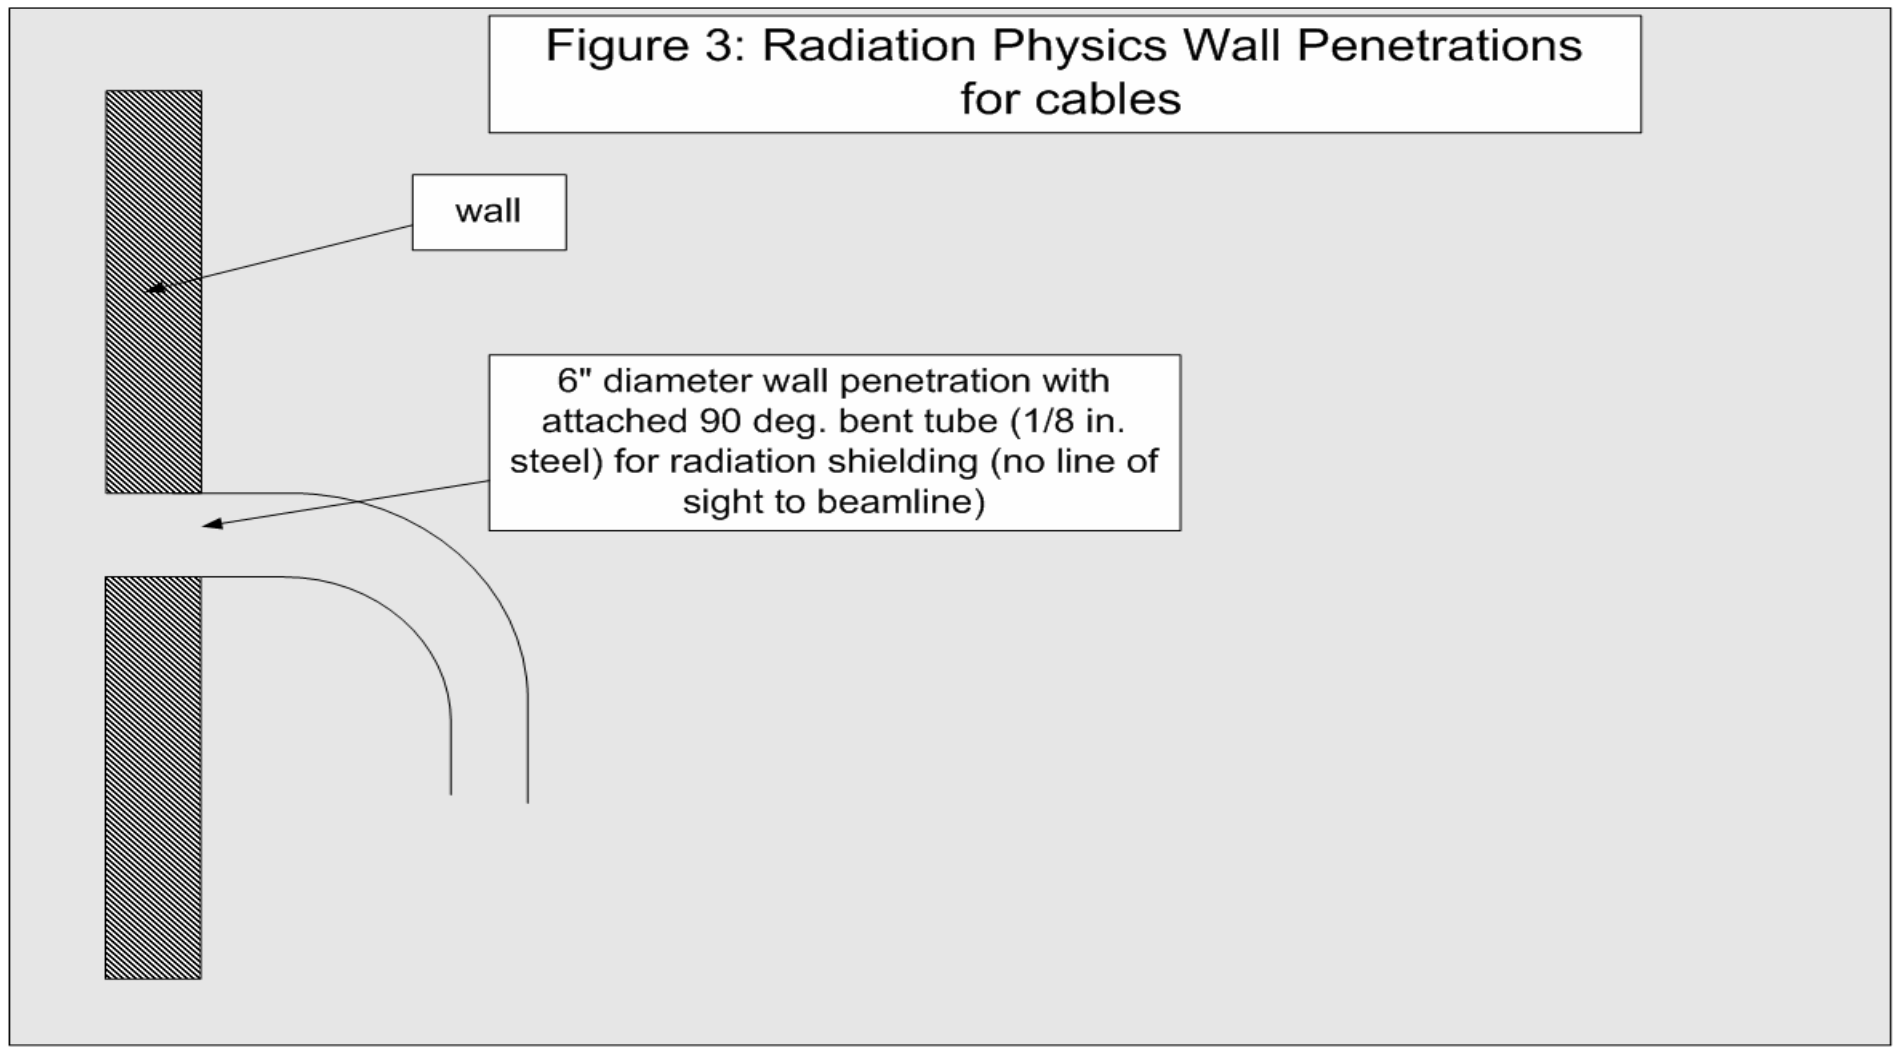


FIGURE No. 4

